



ARCHITECTURAL RECESSED

CEILING MOUNT APPLICATIONS

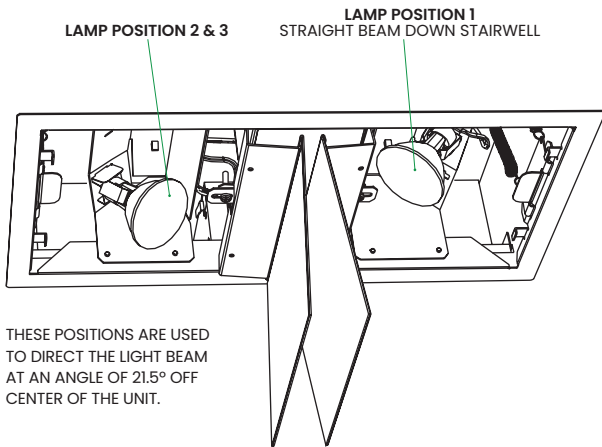

SPECIAL CEILING MOUNT APPLICATIONS

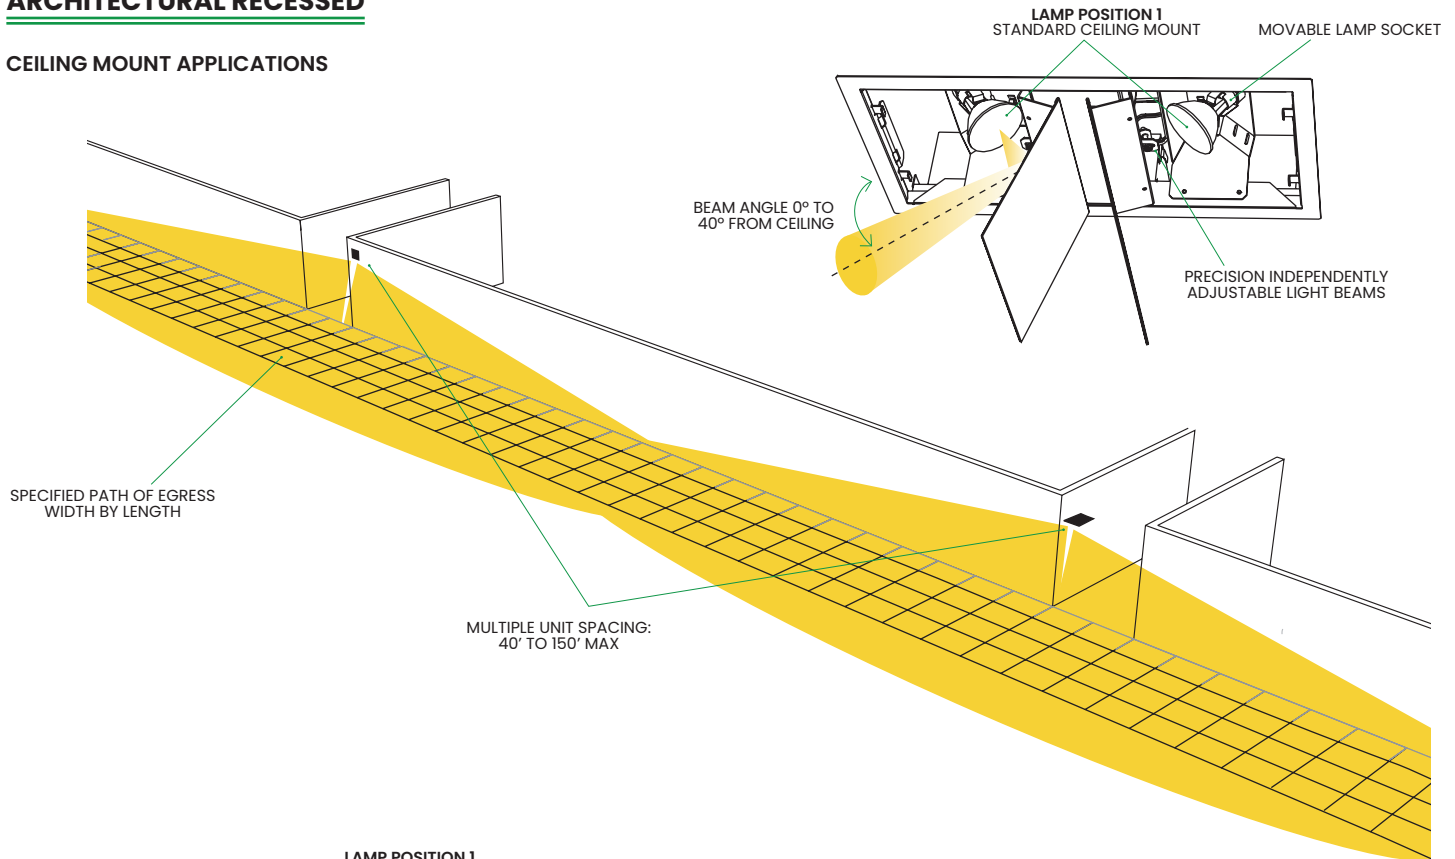

NOTES

Compliance with the Life Safety Code NFPA 101, Section 7.9.2.1 requires even illuminance, over a specified area, of 1fc average with a minimum illumination of 0.1fc at any point with a ratio of not more than 40 to 1 maximum to minimum illuminance.

To meet this requirement Mirrorlite uses reflected and direct illumination that is matched, in wattage, to the size of the area to be illuminated. Precision independently adjustable light beams allow precise positioning for even coverage.

ARCHITECTURAL RECESSED

WALL MOUNT APPLICATIONS

